



# VANI ANALYTICAL RESEARCH PRIVATE LIMITED

(An ISO 9001:2015, ISO 14001:2015, ISO 45001:2018 Certified Laboratory)

KHASRA NO. 384, SHAHPUR FAGOTA, HAPUR (U.P.) - 245101

GSTIN : 09AAKCV4471H1ZW | CIN : U71200UP2024PTC209530

Website : www.vanianalytical.com, E-mail : Info@vanianalytical.com

E-mail : varpllab2024@gmail.com | Mob.: 7253801909, 6398894586, 9760702056



TC-17098

## TEST REPORT

TEST REPORT NO.: VARPL/TR/22042026/010

DATE OF REPORT: 22.04.2026

### WATER SAMPLE ANALYSIS REPORT

Name And Address of Customer : M/S, MODERN ERA PUBLIC SCHOOL  
MONDAWAR ROAD, BIJNOR

Date of Sampling : 18.04.2026  
 Analysis Start Date : 20.04.2026  
 Analysis End Date : 22.04.2026  
 Sample ID No. : VARPL/DW/20042026/001  
 ULR Number : TC170982600001478F  
 Sampling Done By : VARPL STAFF (SHIVAM KUMAR)  
 Sampling Description : DRINKING WATER  
 Sampling Location : FROM R.O (SCHOOL PERMISES)  
 Sampling Method : VARPL/SOP/QSP/010A  
 Sample Quantity : 2.0 + 0.5 LTR.  
 Packing Condition : SEALED  
 Packed In. : P.V.C. & GLASS BOTTLE


S. No.	Test Parameters	Unit	Result	Specification/Limit (As per IS:10500:2012)		Test Method
				Desirable	Permissible	
1	Colour	Hazen	2.0	5	15	IS 3025 (Part-4)
2	Odour	...	Agreeable	Agreeable	Agreeable	IS 3025 (Part 5)
3	Taste	...	Agreeable	Agreeable	Agreeable	IS 3025 (Part 8)
4	pH	...	7.06	6.5 - 8.5	No Relaxation	IS 3025 (Part 11)
5	Turbidity	NTU	0.5	1	5	IS 3025 (Part-10)
6	Total Dissolved Solids,(TDS)	mg/L	132.0	500	2000	IS 3025 (Part 16)
7	Chlorine (Residual)	mg/L	<0.1	0.2	1	IS:3025 (PART-26)
8	Fluoride,(F)	mg/L	<0.1	1	1.5	IS 3025 (Part 60 Sec 1)
9	Total Alkalinity,(CaCO <sub>3</sub> )	mg/L	48.0	200	600	IS 3025 (Part 23)
10	Total Hardness,(CaCO <sub>3</sub> )	mg/L	50.0	200	600	IS:3025(P-21):
11	Calcium,(Ca)	mg/L	11.2	75	200	IS 3025 (Part 40)
12	Chloride,(Cl)	mg/L	31.5	250	1000	IS 3025 (Part 32)
13	Magnesium,(Mg)	mg/L	5.85	30	100	IS 3025 (Part 46)
14	Nitrate,(NO <sub>3</sub> )	mg/L	<0.3	45	No Relaxation	IS: 3025 (Part- 34,Sec 1)
15	Sulphate,(SO <sub>4</sub> )	mg/L	6.85	200	400	IS 3025 (Part24, Sec-1)
<b>Microbiological Parameters: -</b>						
16	Escherichia coli	Cfu/ml	<1.0	Shall Not Be Detectable in any 100 ml sample		IS15185
17	Coliform Count	Cfu/ml	<1.0	Shall Not Be Detectable in any 100 ml sample		IS15185

Remarks:- Based on above tested parameter, water sample meets as per IS-10500:2012 in Specification

Page 1 of 1

For Vani Analytical Research Pvt. Ltd

\*\*\*\*\*End of Test Report\*\*\*\*\*

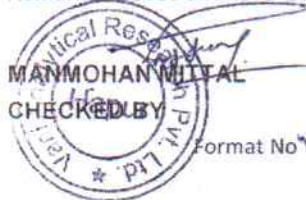

MANMOHAN MITTAL

CHECKED BY

Format No VARPL/QSP/QF/7.8/01, Issue No. 01, Date 01.01.2025, Rev. No. 00 Date 00/00/0000

AUTHORIZED SIGNATORY

Shardha Gupta  
Quality Manager

#### Note :-

- The results indicated only refer to the tested samples and listed applicable parameters.
- No complaint will be entertained if received after 7 days of issue of test report.
- Our liability is limited to invoice value only.
- The sample shall be destroyed after 15 days & Biological / Perishable sample shall be destroyed immediately after issue of test report/
- This test report shall not be used in any advertising media or as evidence in the court of Law without prior written permission of the laboratory.

Signature  
11/05/26

Principal  
Modern Era Public School  
Mandawar Road, BIJNOR  
246791 (U.P.)



Signature  
Manager  
Modern Era Public School  
BIJNOR (U.P.)